


ELECTRICAL PACKAGE - Job#3864344

NO	TAG	PACKAGE #	LOCATION	SWITCHES		OPTION	FANS CONTROLLED				
				LOCATION	QUANTITY		TYPE	#	H.P.	VOLT	FLA
1		DCV-2111	Utility Cabinet Right	04 - Utility Cabinet Right	1 Light	Smart Controls DCV	Exhaust	3	0.500	208	2.0
							Exhaust	3	1.000	208	3.8
				Hood # 1	1 Fan		Supply	3	2.000	208	6.1





CASLink Monitor and Control

- Hood control panel to support communications to cloud-based Building Management System.
- Hood Control Panel to allow cloud-based Building Management System to monitor real time parameters outlined as MONITOR in the points list.
- Hood Control Panel to allow cloud-based Building Management System to control parameters outlined as CONTROL in the points list.
- Hood control panel to allow remote changes to system settings such as: VFD Frequencies, ECM speeds, temperature set points, fan and wash schedules, etc.

MONITORING AND CONTROL POINTS LIST

DCV Package	Function	DC Package	Function
Room Temperature	MONITOR	Room Temperature	MONITOR
Duct Temperature(s)	MONITOR	Duct Temperature(s)	MONITOR
Exhaust Discharge Temperature	MONITOR	Exhaust Discharge Temperature	MONITOR
Kitchen RTU Discharge Temperature	MONITOR	Kitchen RTU Discharge Temperature	MONITOR
Fan Speed	MONITOR	Exhaust Fan Speed	MONITOR
Fan Voltage	MONITOR	Fan Voltage	MONITOR
Fan Phase	MONITOR	Fan Phase	MONITOR
VFD Faults	MONITOR	VFD Faults	MONITOR
Controler Faults	MONITOR	Controler Faults	MONITOR
Fan Faults	MONITOR	Fan Faults	MONITOR
Fan Status	MONITOR	Fan Status	MONITOR
PCU Faults	MONITOR	PCU Faults	MONITOR
PCU Filter Clog Percentage	MONITOR	PCU Filter Clog Percentage	MONITOR
Free Condition	MONITOR	Free Condition	MONITOR
CORE Fire System	MONITOR	CORE Fire System	MONITOR
Building Presence	MONITOR	Building Presence	MONITOR
Prep Fire Button	MONITOR & CONTROL	Prep Fire Button	MONITOR & CONTROL
Cook Button	MONITOR & CONTROL	Cook Button	MONITOR & CONTROL
Light Button	MONITOR & CONTROL	Light Button	MONITOR & CONTROL
Wash Button	MONITOR & CONTROL	Wash Button	MONITOR & CONTROL

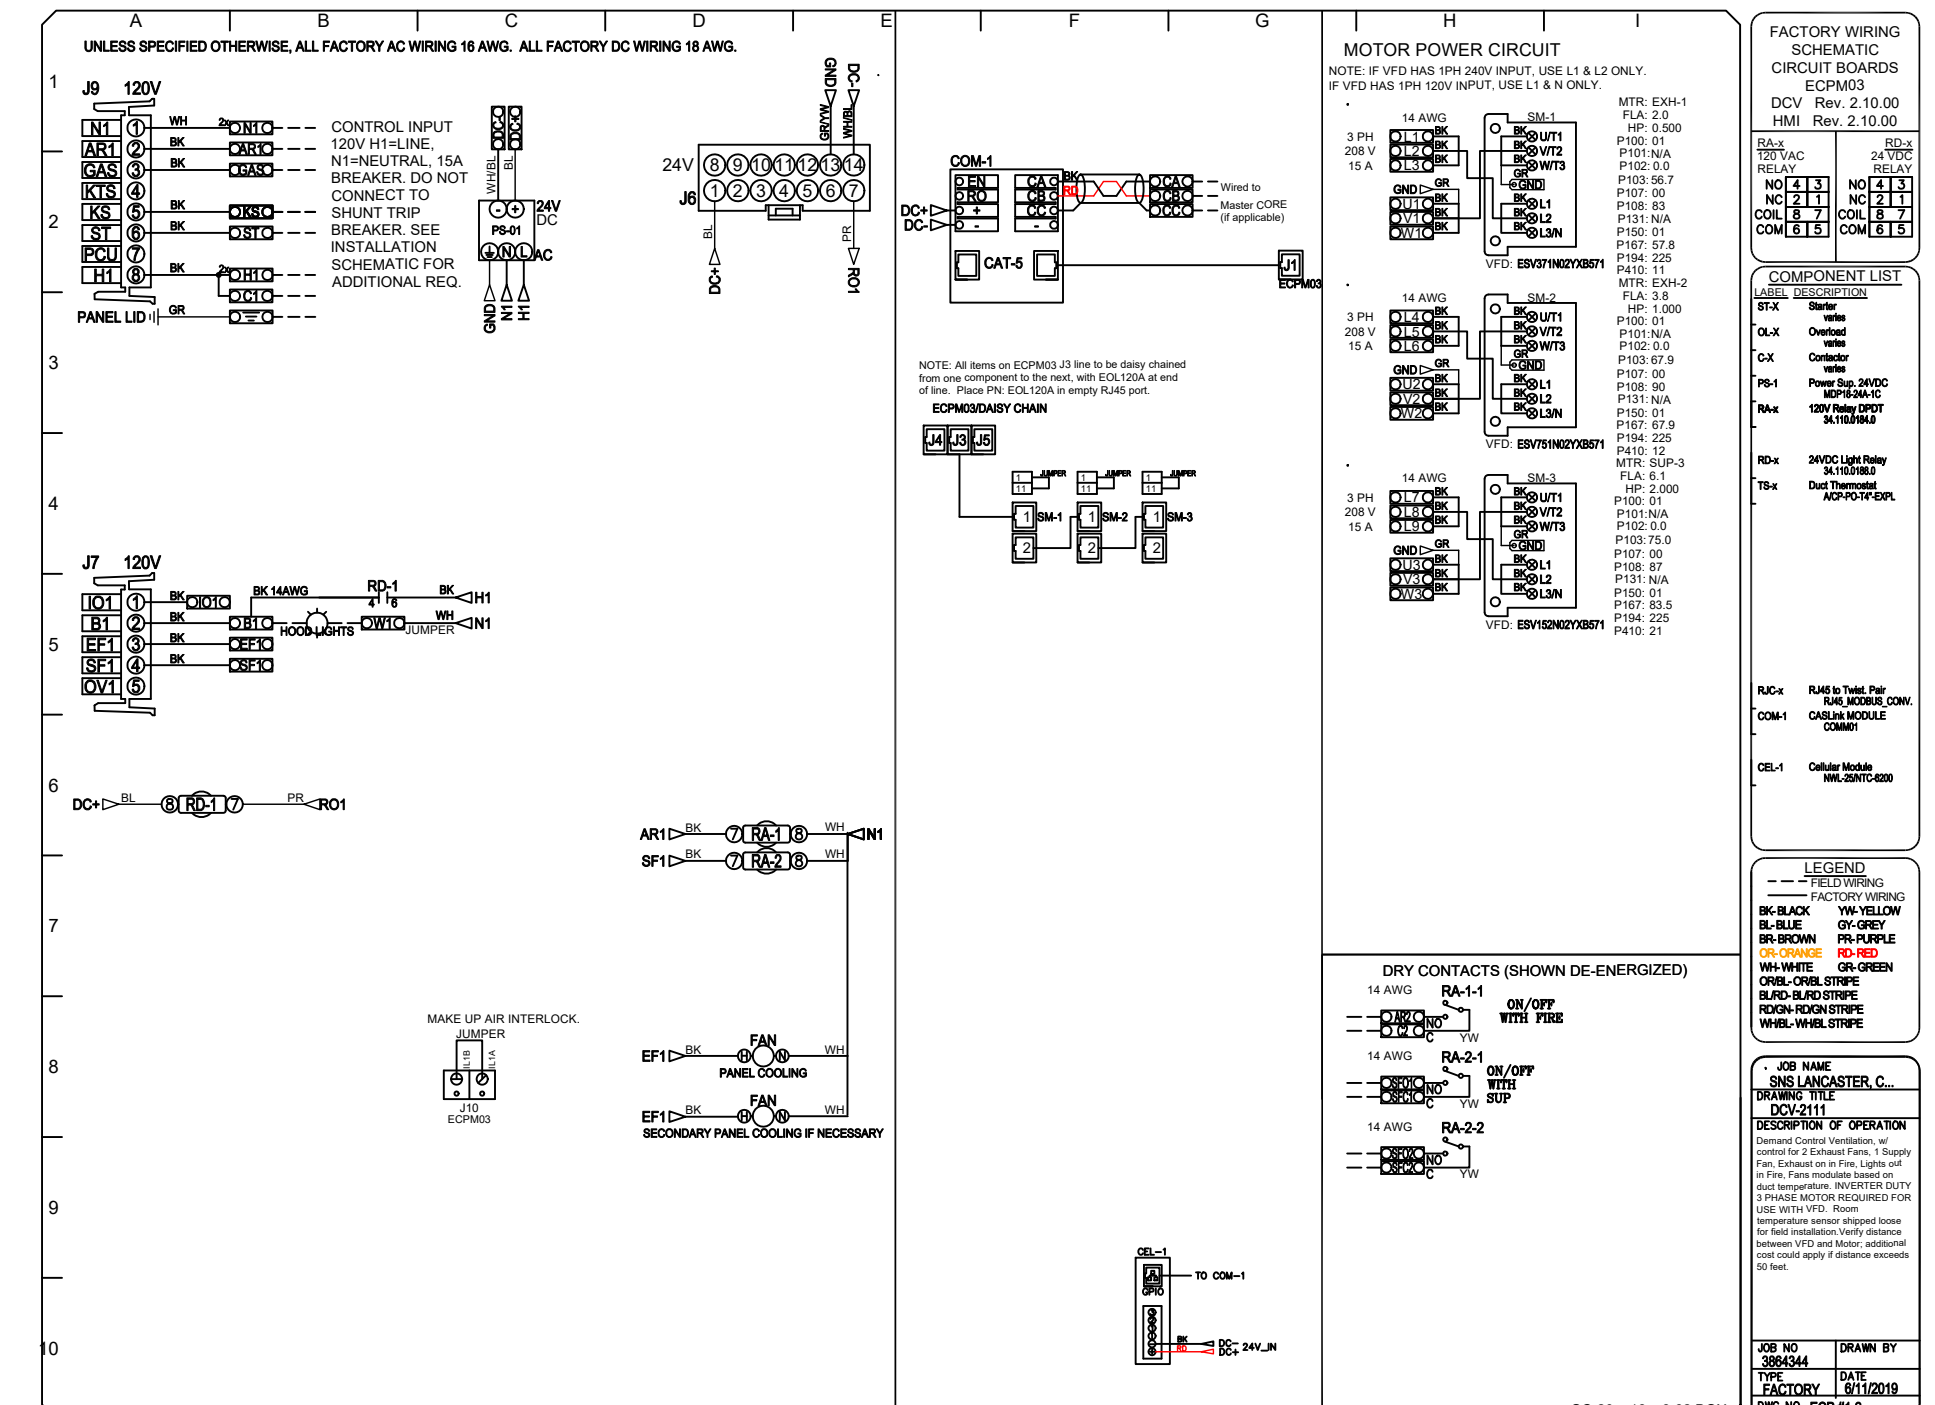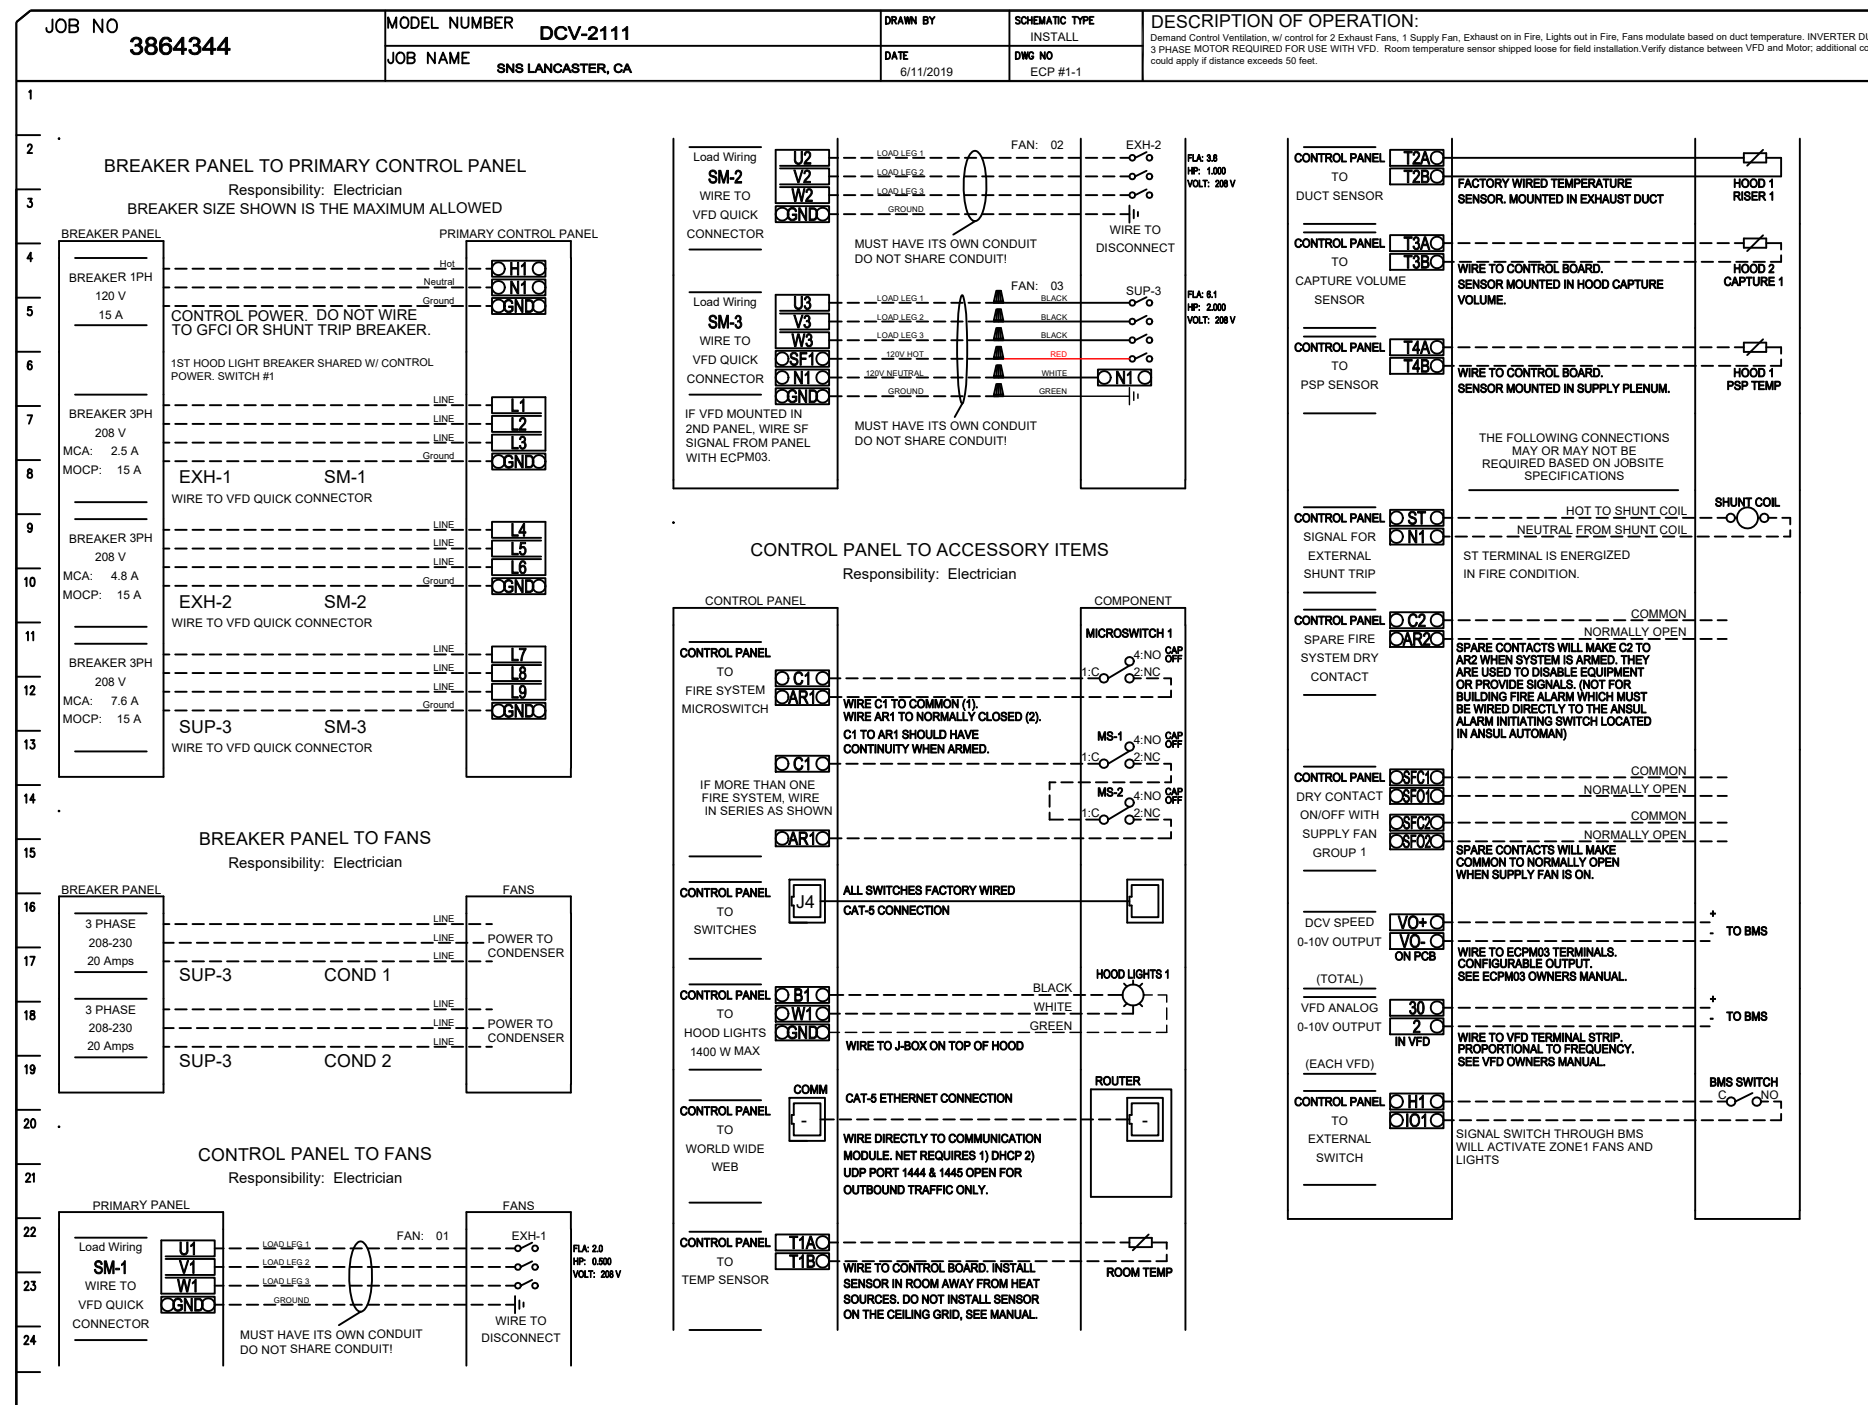

REVISIONS

DESCRIPTION	DATE

CAPTIVE

Indiana Office

20 E. Airport Rd. Ste. 100, Brownsburg, IN 46112 PHONE: (317) 852-3770 FAX: (919) 227-5929 EMAIL: reg56@captiveire.com


SNS LANCASTER, CA
LANCASTER, CA, 93536

DATE: 6/11/2019
DWG.#: 3864344
DRAWN BY: DCM-56
SCALE: 3/4" = 1'-0"
MASTER DRAWING

SHEET NO.
8

Demand Control Ventilation Hood Control Panel Specifications:

- Controls shall be listed by ETL (UL 508A) and shall comply with demand ventilation system shutdown requirements outlined in IECC 403.2.8 (2015).
- The control enclosure shall be NEMA 1 rated and listed for installation inside of the exhaust hood utility cabinet. The control enclosure may be constructed of stainless steel or painted steel.
- Temperature probe(s) located in the exhaust duct riser(s) shall be constructed of stainless steel.
- A digital controller shall be provided to activate the hood exhaust fans dynamically based on a fixed differential between the ambient and duct temperatures sensors. This function shall meet the requirements of IMC 507.1.1.
- A digital controller shall provide adjustable hysteresis settings to prevent cycling of the fans after the cooking appliances have been turned off and/or the heat in the exhaust system is reduced.
- A digital controller shall provide an adjustable minimum fan run-time setting to prevent fan cycling.
- Variable Frequency Drives (VFDs) shall be provided for fans as required. The digital controller shall modulate the VFDs between a minimum setpoint and a maximum setpoint on demand. The duct temperature sensor input(s) to the digital controller shall be used to calculate the speed reference signal.
- The VFD speed range of operation shall be from 0% to 100% for the system, with the actual minimum speed set as required to meet minimum ventilation requirements.
- An internal algorithm to the digital controller shall modulate supply fan VFD speed proportional to all exhaust fans that are located in the same fan group as the supply fan.
- The system shall operate in PREP MODE during light cooking load or COOL DOWN MODE when sufficient heat remains underneath the hood system after cooking operations have completed. Operation during either of these periods will disable the supply fans and provide an exhaust fan speed that is equal to the minimum ventilation requirement.
- A digital controller shall disable the supply fan(s), activate the exhaust fan(s), activate the appliance shunt trip, and disable an electric gas valve automatically when fire condition is detected on a covered hood.
- A digital controller shall allow for external BMS fan control via Dry Contact (external control shall not override fan operation logic as required by code).
- An LCD interface shall be provided with the following features:
 - On/Off push button fan & light switch activation
 - Integrated gas valve reset for electronic gas valves (no reset relay required)
 - VFD Fault display with audible & visual alarm notification
 - Duct temperature sensor failure detection with audible & visual alarm notification
 - Mis-wired duct temperature sensor detection with audible & visual alarm notification
 - A single low voltage Cat-5 RJ45 wiring connection
 - An energy savings indicator that utilizes measured kWh from the VFDs



TYPICAL HOOD CONTROL PANEL INSTALLATION

- Sequence of Operations:**
The hood control panel is capable of operating in one or more of the following states at any given time:
- **Automatic:** The system operates based on the differential between room temperature and the temperature at the hood cavity or exhaust duct collar. Fans activate at a configurable temperature differential threshold. Depending on the job configuration each fan zone can be configured as static or dynamic. These terms refer to whether a variable motor (such as EC Motors or VFD driven motors) modulate with temperature. If the panel is equipped with variable speed fans and the zone is defined as "dynamic", these will modulate within a user-defined range based on the temperature differential. Panels equipped with variable speed fans and a fan zone defined as "static", fans will run at a set speed calculated for the drive. Demand control ventilation systems are capable of modulating exhaust and make up air fan speeds per the requirements outlined in IECC 403.2.8.
 - **Manual:** The system operates based on human input from an HMI.
 - **Schedule:** A weekly schedule can be set to run fans for a specified period throughout the day. There are three occupied times per day to allow for the user to set up a time that is suitable to their needs. Any time that is within the defined occupied time, the system will run at modulation mode and follow the fan procedure algorithm based on temperature during this time. During unoccupied time, the system will have an extra offset to prevent unintended activation of the system during a time where the system is not being occupied.
 - **Other:** The system operates based on the input from an external source (DDC, BMS or hard-wired interlock)